


NOTE: FINISH VANITIES 3 1/2"

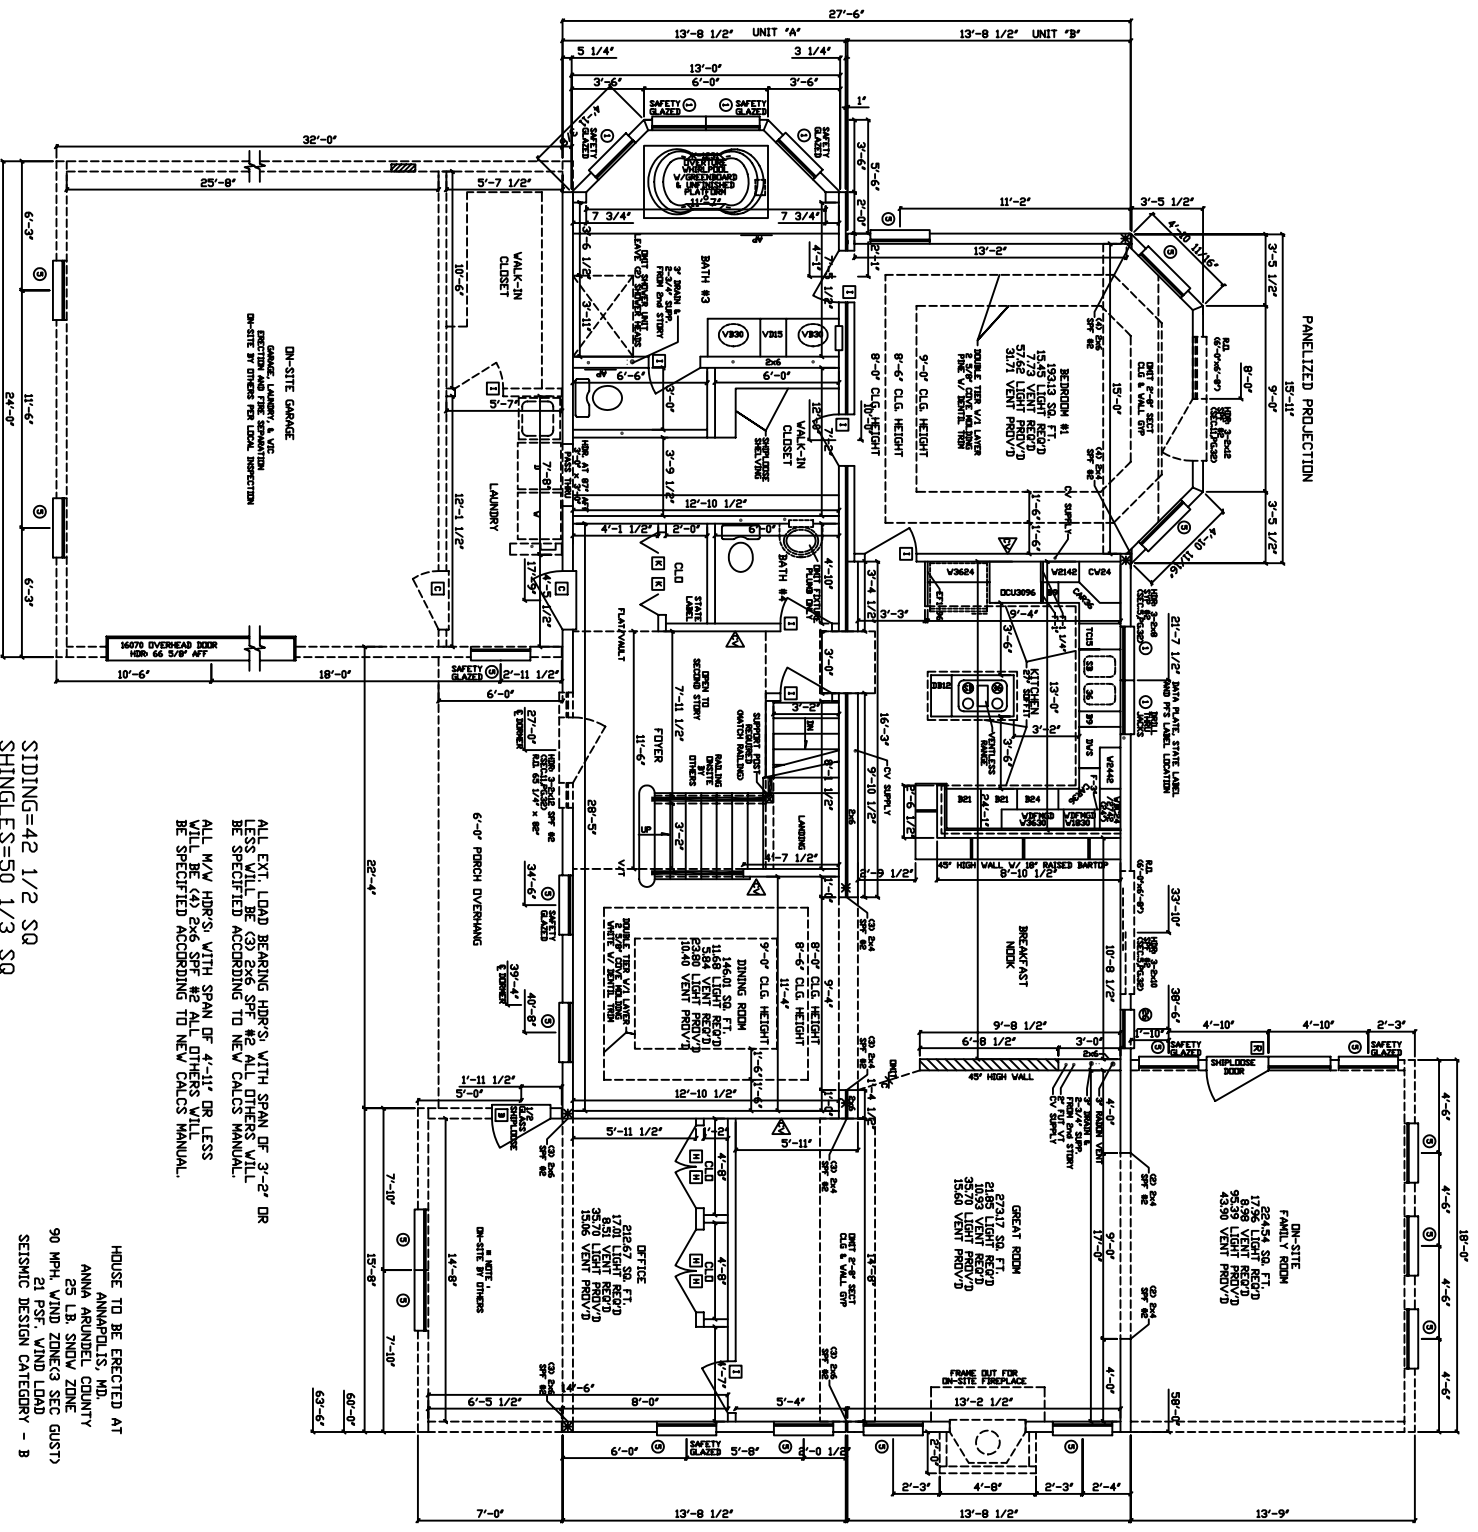

PANELLIZED PROJECTION

ALL EXT. LOAD BEARING HRS'S. WITH SPAN OF 4'-11" OR LESS WILL BE (4) 2x6 SP #2 ALL OTHERS WILL BE SPECIFIED ACCORDING TO NEW CALCS MANUAL.

ALL M/W HRS'S. WITH SPAN OF 4'-11" OR LESS WILL BE (4) 2x6 SP #2 ALL OTHERS WILL BE SPECIFIED ACCORDING TO NEW CALCS MANUAL.

SIDING=42 1/2 SQ  
SHINGLES=50 1/3 SQ

HOUSE TO BE ERRECTED AT  
ANNAPOLIS, MD.  
ANNA ARONDEL COUNTY  
25 LB. SNOW ZONE  
90 MPH. WIND ZONE 3 SEC GUST  
21 PSF. WIND LOAD  
SEISMIC DESIGN CATEGORY - B